



PRODUCT CATALOG version 2024-11EN
DRY TYPE TRANSFORMER



HENGFENGYOU ELECTRIC GROUP

Smart Electric Global Service provider

Make life better!



www.hengfengyou.com

CATALOGUE

▪ Company profile	01
▪ Certificate	02
▪ Product overview	03
▪ Product advantage	05
▪ SQA Management	08
▪ Our factory	09
▪ Technical Parameter	12
▪ TEST	18
▪ Installation and after-sales	20



ABOUT

HENGFENGYOU ELECTRIC GROUP

HENGFENGYOU ELECTRIC GROUP, is an electrical enterprise with transmission and distribution industry as its main business, integrating product research and development, manufacturing and trade. Designated suppliers for the world's top 500 enterprises. Its main products include power transformers, medium and low voltage switchgear, distribution panel, circuit breakers, transmission tower, Cable and other power distribution equipment. The group has five departments: Transformer department, Panel department, power transmission tower department, cable department and electrical engineering department. HENGFENGYOU ELECTRIC GROUP has been working hard to provide the best transmission, distribution solutions for users all over the world.

Key figures

- Since: 1990
- Revenue in 2018: 635 million (RMB)
- 550 employees and 30 Electrical Engineers
- 6 production sites in China
- 6% of revenue is invested in R & D

Power distribution solutions that drive the global energy transition

With energy demand expanding in both developed and emerging countries, the challenge for HENGFENGYOU ELECTRIC GROUP is to connect energy with people. The group's teams work as closely as possible with projects and decision makers and design and propose technical and process solutions based on global user needs.



Qingdao Hengfengyou Electrical Engineering Co., Ltd
Address: NO.638 Zhongcheng Road, Chengyang District, Qingdao City, China
Tel: +86-532--87936206
Website: <http://www.hengfengyou.com>
Sales: hfy@hengfengyou.com Service: service@hengfengyou.com



QUALIFICATION CERTIFICATION



OUR PARTNER



🔄 PRODUCT OVERVIEW

- The actual measurement of the product is superior to GB and IEC standards, CB CCC KEMA SASO certification, etc
- Safer, better fire performance, F1 level
- High lightning impulse resistance level (95kV for 11kv products)
- Equipped with perfect temperature protection and control system, it can operate at 120% of rated load under forced air cooling conditions
- The high reliability of operation verification in more than 50 countries and regions around the world has been sold to: Iraq, Kuwait, UAE, Libya, Zimbabwe, South Africa, Uganda, Rwanda, Ethiopia, Ghana, Uzbekistan, Kazakhstan, Pakistan, Vietnam, Nepal, Bangladesh, Indonesia and other countries, with a cumulative export of 13592 sets
- It is mainly used in urban distribution network below 35KV, power supply and distribution system of industrial and mining enterprises and civil buildings
- Executive standard: IEC 60076 series, GB1094 series, GB / T 6451-2008
- The shell materials include aluminum alloy, cold rolled steel plate, stainless steel, etc. for users to choose (protection grade IP20, IP23, etc.)



🔄 PRODUCT OVERVIEW

Conditions of use

- Altitude less than 1000m, air temperature -25°C~40°C, humidity less than 90% (+25°C)
- the vertical inclination shall not exceed 5°, and the outdoor wind speed shall not exceed 35m/s without severe vibration
- No gas or conductive dust seriously affecting transformer insulation; Places free from explosion hazard and corrosion of electrical components
- Beyond the above normal operating conditions, customers can be customized with our company to solve

Standard

The actual measurement of products is better than GB and IEC standards

IEC CB CCC COC KEMA STL SABS certification

Implementation standards:

IEC 60076 series, IEC 6013, IEC 6024-1, IEC 60296

GB 1094-1996, GB/T 6451-2008, GB/ T 7537-2007

"Smart electrical global service provider, make life better"

Hengfengyou Electric always provides the best oil immersed distribution transformer solutions for users all over the world, continuously improves product quality, reduces production costs, improves service level, and strives to become a world-class electrical service provider!



🔄 PRODUCT ADVANTAGE

Leading technology



High voltage copper tape winding technology to improve lightning resistance
Low voltage copper foil winding technology, high quality A grade insulation material insulation
Small magnetic leakage, high mechanical strength, short circuit resistance
Core 45° fully inclined joint step laminated structure

The iron core

The iron core is made of high quality cold-rolled grain oriented silicon steel sheet with mineral oxide insulation (from Baosteel and WISCO of China).

By controlling the cutting and stacking process of silicon steel sheet, the loss level, no-load current and noise can be minimized


The iron core is specially reinforced to ensure the structure of the transformer is firm during normal operation and transportation

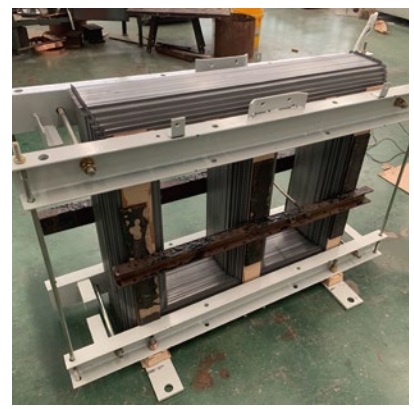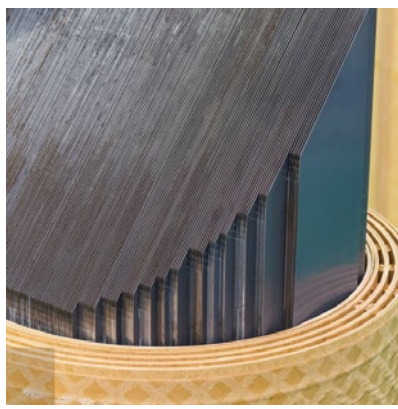


Winding

The low voltage winding is made of high quality copper foil with excellent insulation resistance

High voltage winding is usually made of insulated copper wire, using hengfengyou electric patented technology

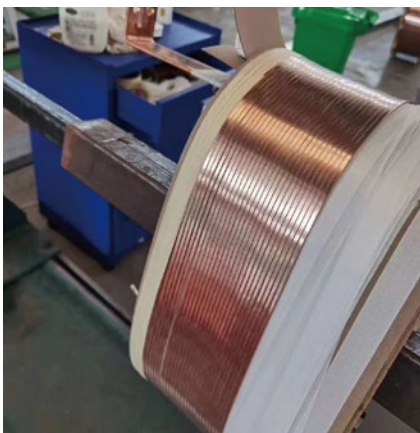

🌀 PRODUCT ADVANTAGE

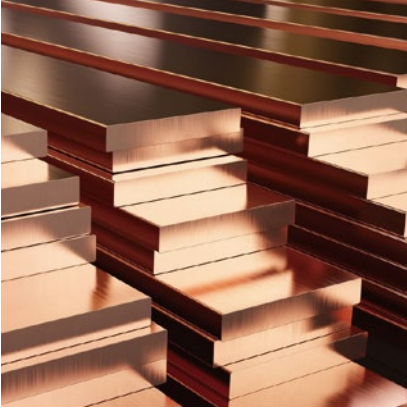

High quality material

Baosteel and WISCO produce silicon steel sheets
China's high quality oxygen free copper
CNPC (Kunlun Petroleum) High quality transformer oil (25#)

Patent technology

Thanks to hengfengyou Electric "ultra-low loss energy-saving power transformer" patent technology, can achieve 5% material savings, transformer loss than similar products in the market reduced 10-20%, more energy saving and environmental protection.






Other instructions

The low-voltage outlet terminal is a tin-plated copper bar
High voltage outlet terminals are tin-plated ring bolts
Default no-load voltage regulation (can be customized) tap switch 5 or 7 gear adjustment
Transformer above 630KVA is equipped with gas relay protection.




③ PRODUCT ADVANTAGE

- Authoritative certification: ISO, ANSI, CB, SASO etc
- Perfect SQA quality management system and patented technology to ensure high quality products
- Efficient production equipment and low raw material prices to ensure the price advantage
- Sufficient inventory, short delivery time and fast delivery worldwide
- Perfect after-sales service system, allowing customers to buy worry-free
- Provide OEM/ODM services. Welcome clients to visit our factory.

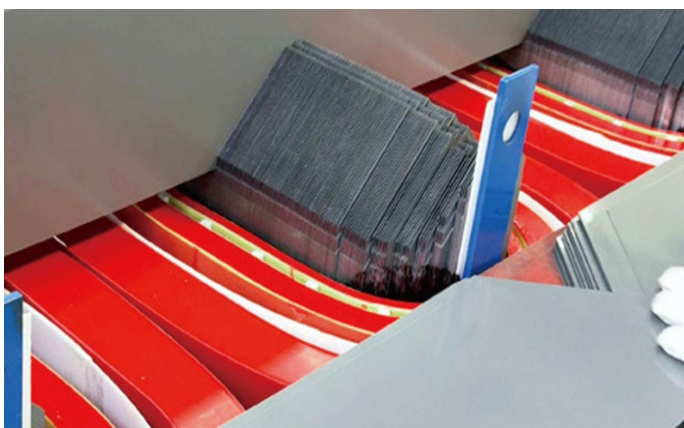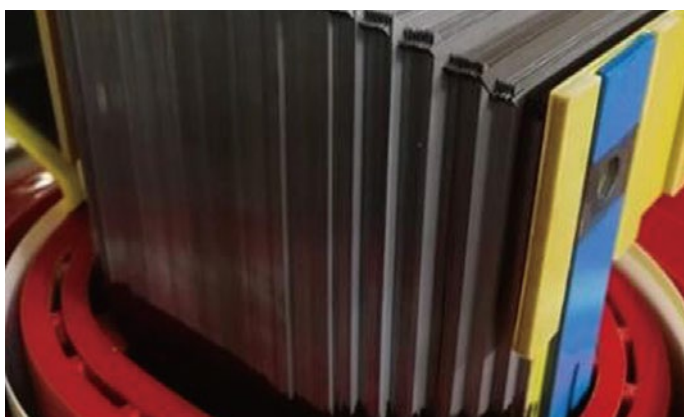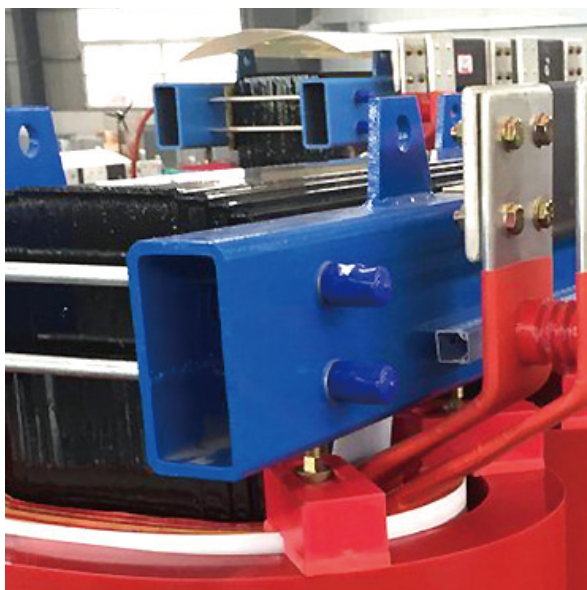

SQA MANAGEMENT OF DRY TYPE TRANSFORMER

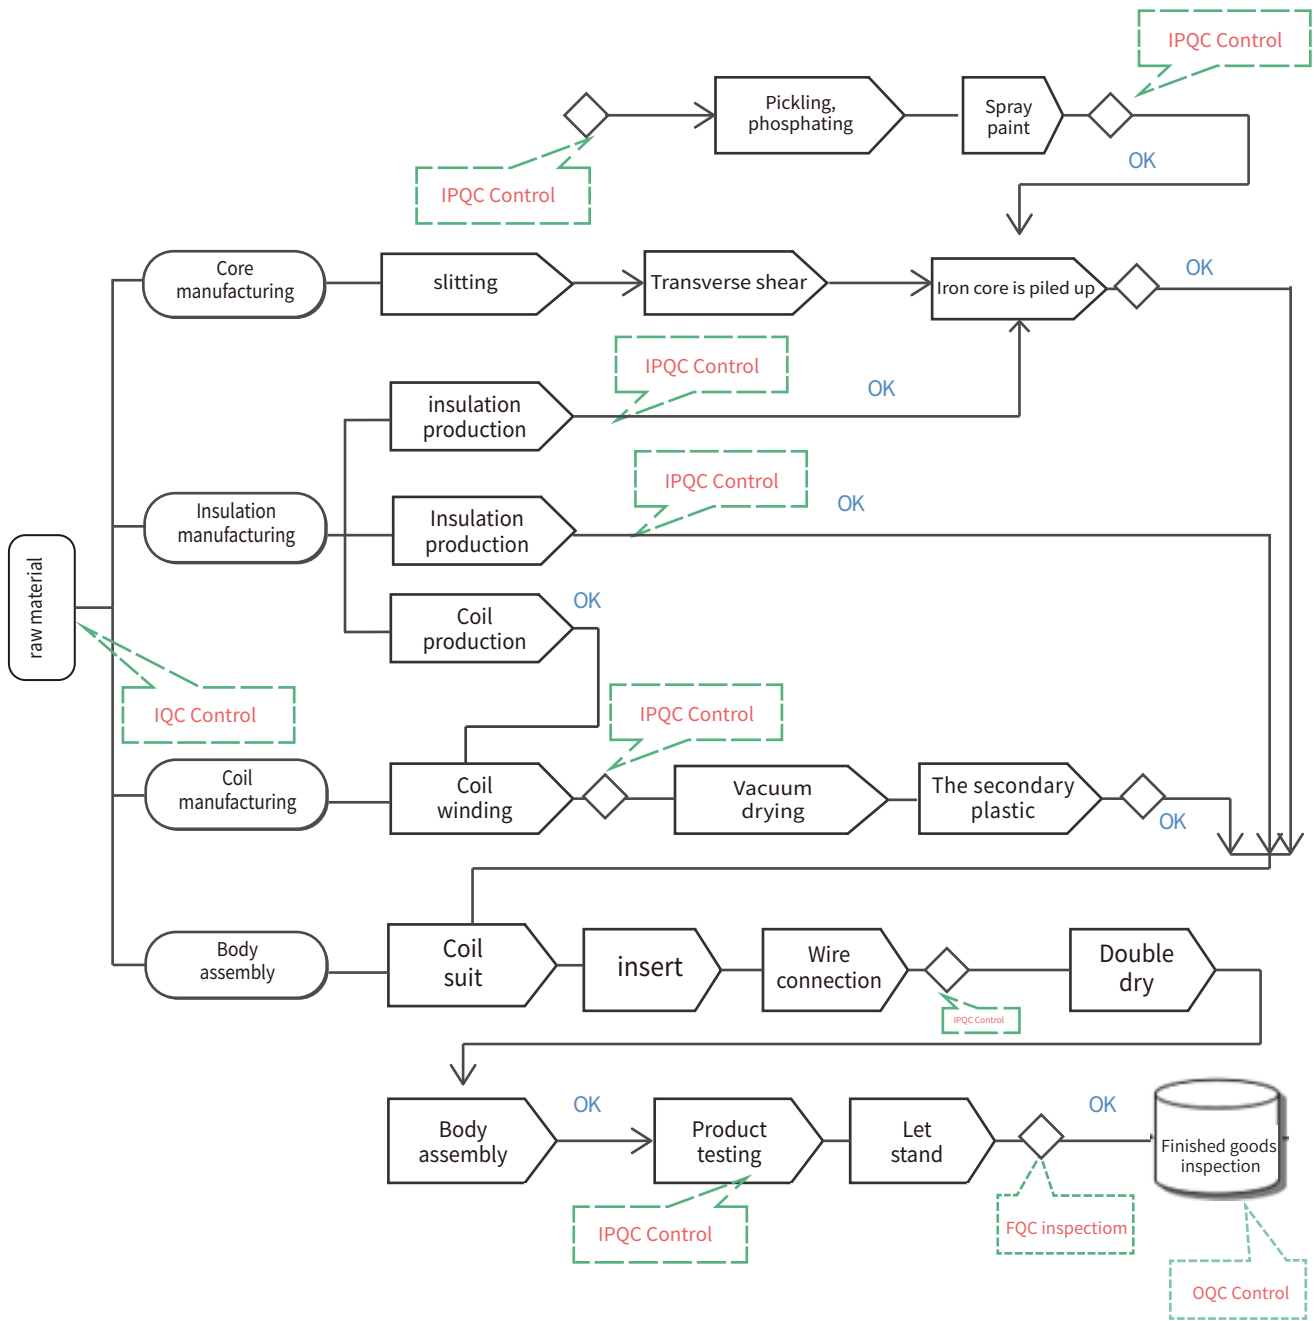

🕒 OUR PRODUCTION EQUIPMENT

The company mainly produces more than 300 sets of equipment, and the key equipment includes the full-automatic vacuum resin casting equipment of Hubers company, 400 / 600mm core automatic cross cutting machine, foil winding machine, the most advanced transformer kerosene vapor phase drying equipment in China, large-scale core stacking turnover platform, large scale assembly platform, etc




Silicon steel sheet crosscutting machine



🕒 THE CORNER OF OUR FACTORY

Hengfengyou Electric has 22000 square meters of modern plant, with a monthly delivery capacity of up to 500 distribution transformers, and has fully passed the ISO9001, ISO14001, SA8000, BSCI and other market access standards reviewed and issued by international certification bodies. At present, the company has 10 senior engineers, 30 senior technicians and more than 300 employees, with an annual output value of US \$100 million.

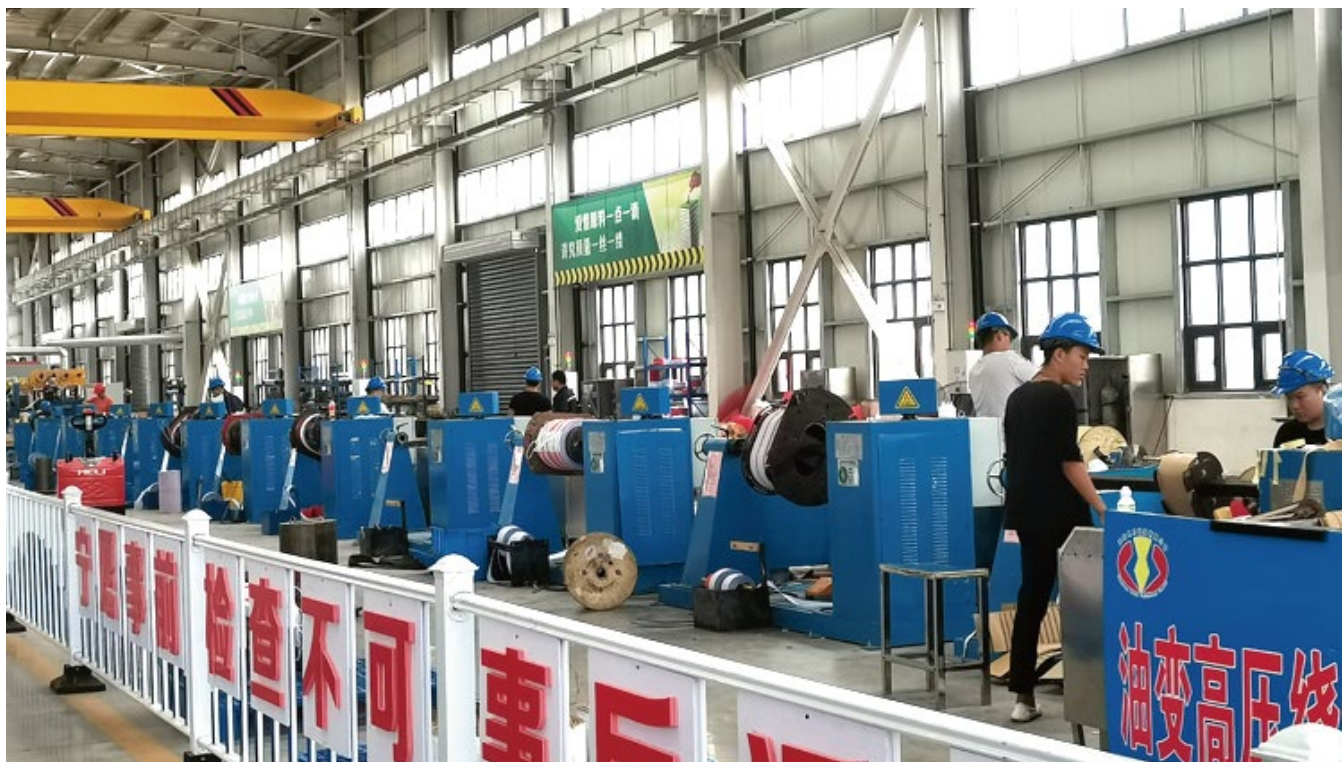





CUSTOMER-ORIENTED CREATE VALUE FOR CUSTOMERS
MAKE FRIENDS ALL OVER THE WORLD

TECHNICAL PARAMETERS


SCB10 10KV/11KV Three-phase Dry Type Transformer

Rating (kva)	High vologe (kV)	High voltage tap range (%)	Low vologe (kV)	connection symbol	No-Load Loss	Load Loss (w)	No-Load current(%)	Short current impedance(%)				
30	11 10.5	±5% ±2.5%	0.4	Dyn11 Yyn0	190	710	2	4				
50					270	1000	2	4				
80					370	1380	1.5	4				
100					400	1570	1.5	4				
125					470	1850	1.3	4				
160					540	2130	1.3	4				
200					620	2530	1.1	4				
250					720	2760	1.1	4				
315					10 6.6	±5% ±2×2.5%	0.415	Dyn11 Yyn0	880	3470	1	4
400					0.420		980		3990	1	4	
500	0.44	1160	4880	1	4							
630	1340	5880	0.85	4								
630	1300	5960	0.85	6								
800	1520	6960	0.85	6								
1000	1770	8130	0.85	6								
1250	2090	9100	0.85	6								
1600	2450	11700	0.85	6								
2000	3050	14400	0.7	6								
2500	3600	17100	0.7	6								

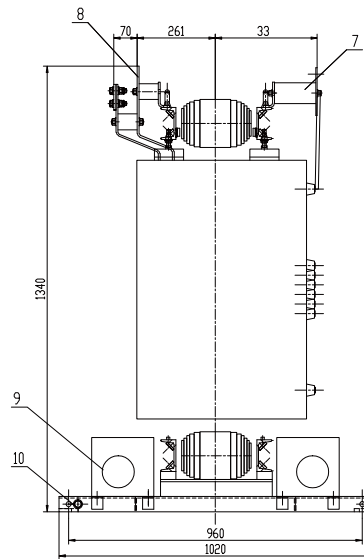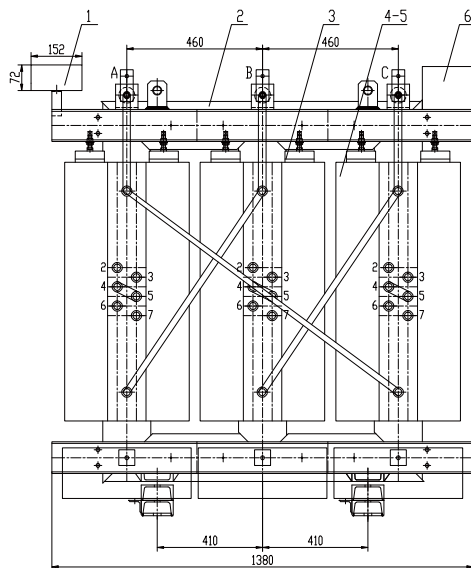


Total weight(kg): 1970

High voltage terminal




Low voltage terminal



- 1 Resistance thermometer
- 2 Iron core assembly
- 3 Body insulation
- 4 High voltage winding
- 5 Low voltage winding
- 6 Nameplate group
- 7 High voltage leads
- 8 Low voltage leads
- 9 Draught fan
- 10 Earth stud

All dimensions are in centimeters



 Qingdao Hengfengyou Electrical Engineering Co.,Ltd Http://www.hengfengyou.com	Design Version	710.1
	Data	3PHRASE 50Hz WINDINGS AL
Model	SCBL10-800/11	Date

Copyright by HENG FENGYOU ELECTRIC 2020

TECHNICAL PARAMETERS


SCB10 35KV/33KV Three-phase Dry Type Transformer

Rating (kva)	High volage (kV)	High voltage tap range (%)	Low volage (kV)	connection symbol	No-Load Loss	Load Loss (w)	No-Load current(%)	Short current impedance(%)
50	35 33	±5% ±2×2.5%	0.4 0.415 0.420 0.44	Dyn11 Yyn0	450	1420	2.3	6
100					630	2090	2.0	6
160					790	2810	1.5	6
200					880	3320	1.5	6
250					990	3800	1.3	6
315					1170	4510	1.3	6
400					1370	5410	1.1	6
500					1620	6650	1.1	6
630					1860	7690	1.0	6
800					2160	9120	1.0	6
1000					2430	10400	0.75	6
1250					2830	12700	0.75	6
1600					3240	15400	0.75	6
2000					3820	18200	0.75	6
2500					4450	21800	0.75	6
3150					6000	22170	0.75	6

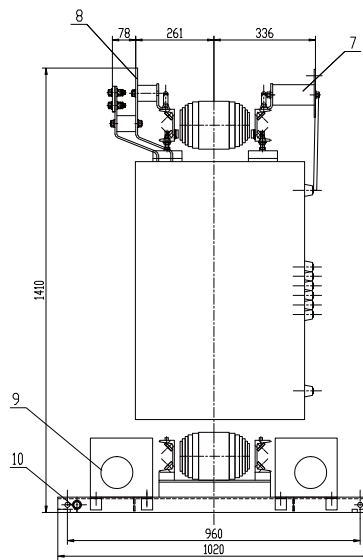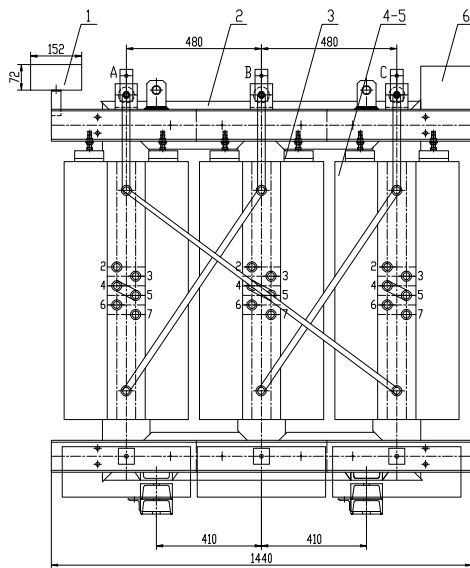

Total weight(kg): 2370

High voltage terminal




Low voltage terminal



- 1 Resistance thermometer
- 2 Iron core assembly
- 3 Body insulation
- 4 High voltage winding
- 5 Low voltage winding
- 6 Nameplate group
- 7 High voltage leads
- 8 Low voltage leads
- 9 Draught fan
- 10 Earth stud

All dimensions are in centimeters



 HENG FENGYOU ELECTRIC - Make Life Better -	Qingdao Hengfengyou Electrical Engineering Co.Ltd	Design Version	710.1
	Http://www.hengfengyou.com	Data	3PHRASE 50Hz WINDINGS AL
Model	SCBL10-1000/11	Date	

Copyright by HENG FENGYOU ELECTRIC 2020

TECHNICAL PARAMETERS


SCB11 10KV/11KV Three-phase Dry Type Transformer

Rating (kva)	High volage (kV)	High voltage tap range (%)	Low volage (kV)	connection symbol	No-Load Loss	Load Loss (w)	No-Load current(%)	Short current impedance(%)			
30	11 10.5	±5% ±2.5%	0.4	Dyn11 Yyn0	170	710	2	4			
50					240	1000	2	4			
80					330	1380	1.5	4			
100					360	1570	1.5	4			
125					420	1850	1.3	4			
160					490	2130	1.3	4			
200					560	2530	1.1	4			
250					650	2760	1.1	4			
315					10 6.6	±5% ±2×2.5%	0.415	790	3470	1	4
400					6.3 6		0.420	880	3990	1	4
500	1045	4880	1	4							
630	1210	5880	0.85	4							
630	1170	5960	0.85	6							
800	1370	6960	0.85	6							
1000	1590	8130	0.85	6							
1250	1880	9100	0.85	6							
1600	2205	11700	0.85	6							
2000	2745	14400	0.7	6							
2500	3240	17100	0.7	6							

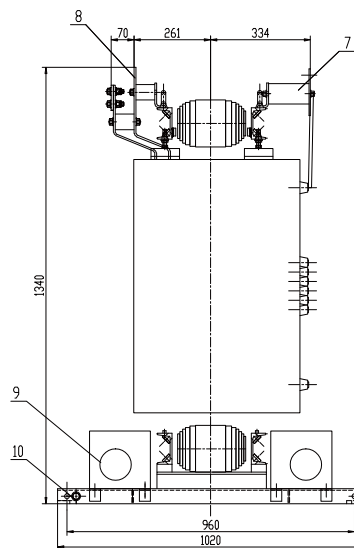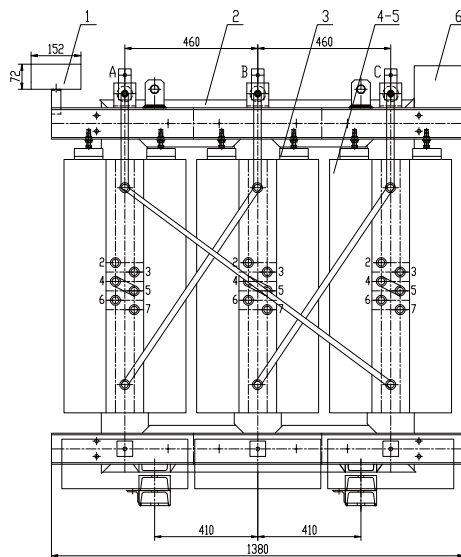


Total weight(kg): 1970

High voltage terminal



Low voltage terminal



- 1 Resistance thermometer
- 2 Iron core assembly
- 3 Body insulation
- 4 High voltage winding
- 5 Low voltage winding
- 6 Nameplate group
- 7 High voltage leads
- 8 Low voltage leads
- 9 Draught fan
- 10 Earth stud

All dimensions are in centimeters



 HENG FENGYOU ELECTRIC - Make Life Better -	Qingdao Hengfengyou Electrical Engineering Co.Ltd Http://www.hengfengyou.com	Design Version	710.1
	Model	SCBL10-800/11	Date

Copyright by HENG FENGYOU ELECTRIC 2020

TECHNICAL PARAMETERS


SCB11 35KV/33KV Three-phase Dry Type Transformer

Rating (kva)	High volage (kV)	High voltage tap range (%)	Low volage (kV)	connection symbol	No-Load Loss	Load Loss (w)	No-Load current(%)	Short current impedance(%)				
50	35	±5%	0.4	Dyn11	405	1420	2.3	6				
100					570	2090	2.0	6				
160					710	2810	1.5	6				
200					795	3320	1.5	6				
250					890	3800	1.3	6				
315					1055	4510	1.3	6				
400					1235	5410	1.1	6				
500					33	±2×2.5%	0.415	Yyn0	1460	6650	1.1	6
630									1675	7690	1.0	6
800									1945	9120	1.0	6
1000									2190	10400	0.75	6
1250									2550	12700	0.75	6
1600									2920	15400	0.75	6
2000									3440	18200	0.75	6
2500									4005	21800	0.75	6
3150					5400	22170	0.75	6				

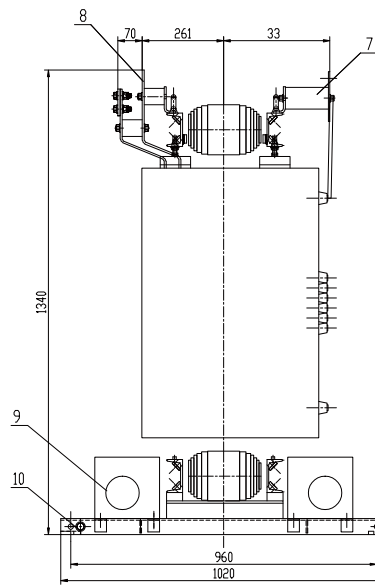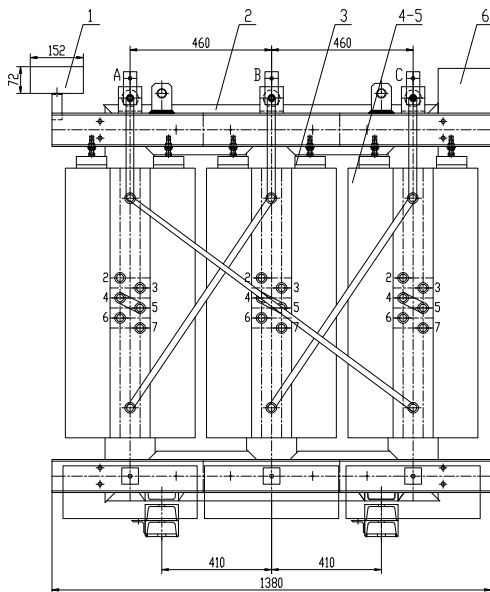


Total weight(kg): 1970

High voltage terminal



Low voltage terminal



- 1 Resistance thermometer
- 2 Iron core assembly
- 3 Body insulation
- 4 High voltage winding
- 5 Low voltage winding
- 6 Nameplate group
- 7 High voltage leads
- 8 Low voltage leads
- 9 Draught fan
- 10 Earth stud

All dimensions are in centimeters



 Qingdao Hengfengyou Electrical Engineering Co.Ltd Http://www.hengfengyou.com	Design Version	710.1
	Data	3PHRASE 50Hz WINDINGS AL
Model	SCBL10-800/11	Date

Copyright by HENGFENGYOU ELECTRIC 2020

TECHNICAL PARAMETERS


SCB12 10KV/11KV Three-phase Dry Type Transformer

Rating (kva)	High volage (kV)	High voltage tap range (%)	Low volage (kV)	connection symbol	No-Load Loss	Load Loss (w)	No-Load current(%)	Short current impedance(%)			
30	11 10.5	±5% ±2.5%	0.4	Dyn11 Yyn0	150	710	2	4			
50					215	1000	2	4			
80					295	1380	1.5	4			
100					302	1570	1.5	4			
125					375	1850	1.3	4			
160					430	2130	1.3	4			
200					495	2530	1.1	4			
250					575	2760	1.1	4			
315					10 6.6	±5% ±2×2.5%	0.415	705	3470	1	4
400					6.3 6		0.420	785	3990	1	4
500	930	4880	1	4							
630	1070	5880	0.85	4							
750	1040	5960	0.85	6							
800	1215	6960	0.85	6							
1000	1415	8130	0.85	6							
1250	1670	9100	0.85	6							
1600	1960	11700	0.85	6							
2000	2440	14400	0.7	6							
2500	2880	17100	0.7	6							

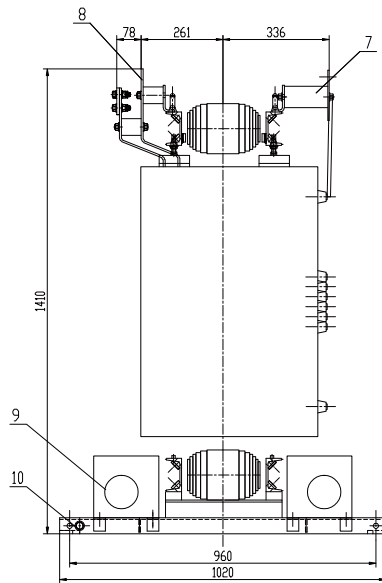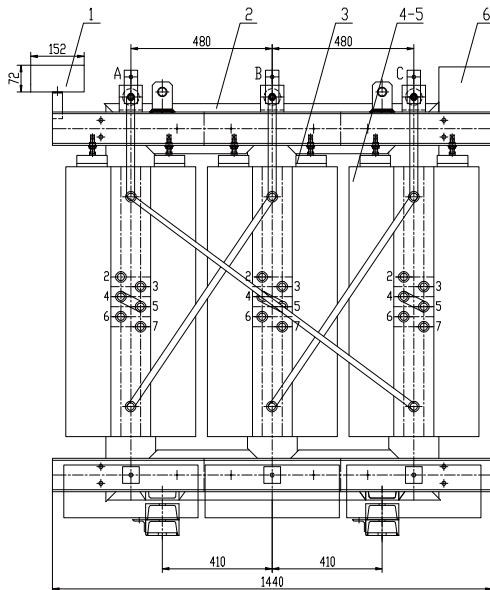

Total weight(kg): 2370

High voltage terminal




Low voltage terminal



- 1 Resistance thermometer
- 2 Iron core assembly
- 3 Body insulation
- 4 High voltage winding
- 5 Low voltage winding
- 6 Nameplate group
- 7 High voltage leads
- 8 Low voltage leads
- 9 Draught fan
- 10 Earth stud

All dimensions are in centimeters



 <p>HENG FENGYOU ELECTRIC - Make Life Better -</p>	Qingdao Hengfengyou Electrical Engineering Co.Ltd Http://www.hengfengyou.com	Design Version	710.1
	Model	SCBL10-1000/11	Data
		Date	

Copyright by HENG FENGYOU ELECTRIC 2020

TECHNICAL PARAMETERS


SCB12 35KV/33KV Three-phase Dry Type Transformer

Rating (kva)	High volage (kV)	High voltage tap range (%)	Low volage (kV)	connection symbol	No-Load Loss	Load Loss (w)	No-Load current(%)	Short current impedance(%)
50	35 33	±5% ±2×2.5%	0.4 0.415 0.420 0.44	Dyn11 Yyn0	360	1420	2.3	6
100					505	2090	2.0	6
160					630	2810	1.5	6
200					705	3320	1.5	6
250					795	3800	1.3	6
315					940	4510	1.3	6
400					1095	5410	1.1	6
500					1295	6650	1.1	6
630					1490	7690	1.0	6
800					1730	9120	1.0	6
1000					1945	10400	0.75	6
1250					2265	12700	0.75	6
1600					2595	15400	0.75	6
2000					3055	18200	0.75	6
2500					3560	21800	0.75	6
3150					4800	22170	0.75	6

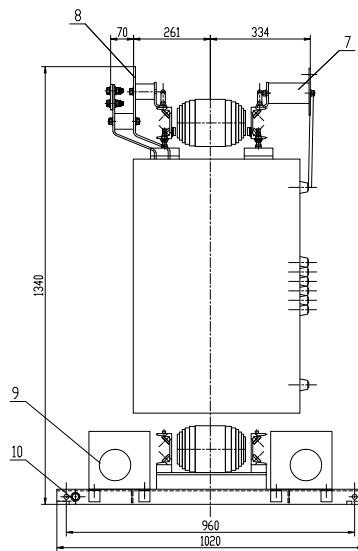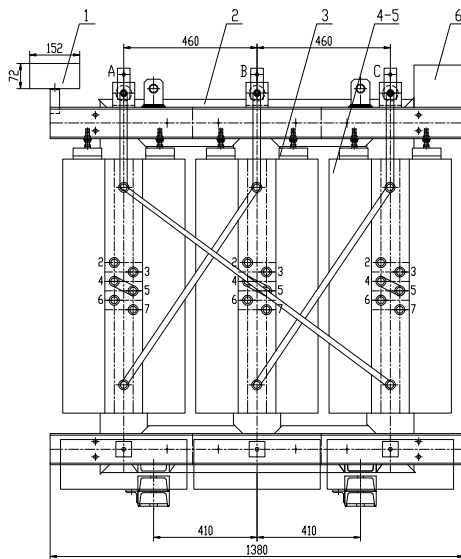


Total weight(kg): 1970

High voltage terminal



Low voltage terminal



- 1 Resistance thermometer
- 2 Iron core assembly
- 3 Body insulation
- 4 High voltage winding
- 5 Low voltage winding
- 6 Nameplate group
- 7 High voltage leads
- 8 Low voltage leads
- 9 Draught fan
- 10 Earth stud

All dimensions are in centimeters

 <p>HENG FENG YOU ELECTRIC - Make Life Better -</p>	Qingdao Hengfengyou Electrical Engineering Co.Ltd Http://www.hengfengyou.com	Design Version	710.1
		Date	3PHRASE 50Hz WINDINGS AL
Model	SCBL10-800/11	Date	

Copyright by HENGFENGYOU ELECTRIC 2020



Comprehensive experimental platform for power transformer

● **Delivery test (or routine test)**

These tests verify the electrical performance specified in the contract. And submit a formal test report.

characteristic measurement

- Winding resistance;
- Transformation ratio and vector group;
- Impedance voltage;
- Load loss;
- No load loss and no-load current.

insulation test:

- Power frequency withstand voltage test- Inductive voltage withstand test.
- Partial discharge measurement ensures that the expected service life of transformer less than 5pc is closely related to the initial partial discharge level measured during manufacturing.



Noise testing chamber

Special test

These tests will be arranged at customer's request at customer's expense.

● **Short circuit test**

These tests were carried out on a special test bench in accordance with IEC 60076-5.

A total of three tests were performed on each transformer column, each lasting 0.5 seconds.

Noise level measurement


- Noise level measurement is part of a special test.
- Transformer noise is mainly caused by magnetostriction of magnetic circuit.
- Noise levels can be expressed in two ways:

Sound pressure level L_p , measured in accordance with IEC 551 at 1m from the transformer in no-load operation



Transformer test

OVERLOAD CAPACITY

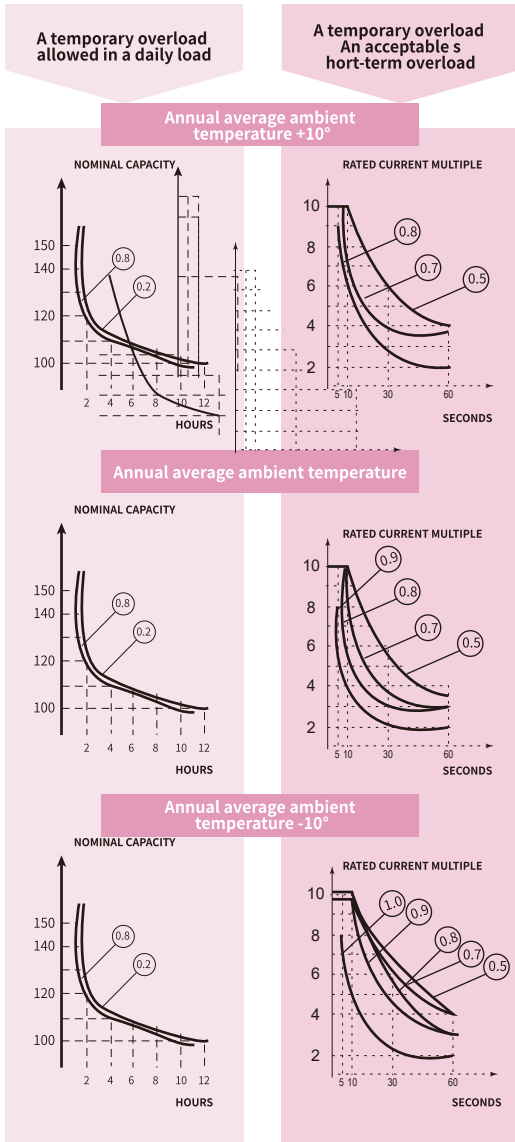

Overload curves at different ambient temperatures

General information

The transformer is designed to operate at rated capacity at ambient temperatures specified in IEC 60076 and GB:

- Maximum temperature +40°C;
- Average temperature of the hottest month +30°C;
- Maximum annual average temperature +20°C.

Unless otherwise specified, the reference temperature is an annual average of 20°C

If it is a normal load within the rated capacity, meet the conditions of overload capacity and time in the left figure


Under, overload operation is allowed and does not affect the life of the transformer

The allowable overload is also subject to the average ambient temperature.


The first column on the left gives the allowed value for the daily overload of the loop.

Column 2 shows acceptable short-time overloads.

The following figure shows the ambient temperature as a function of the acceptable long-term load during the normal life

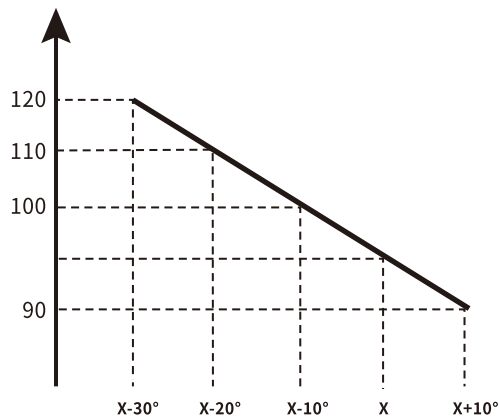

④ INSTALLATION AND AFTER-SALES SERVICE

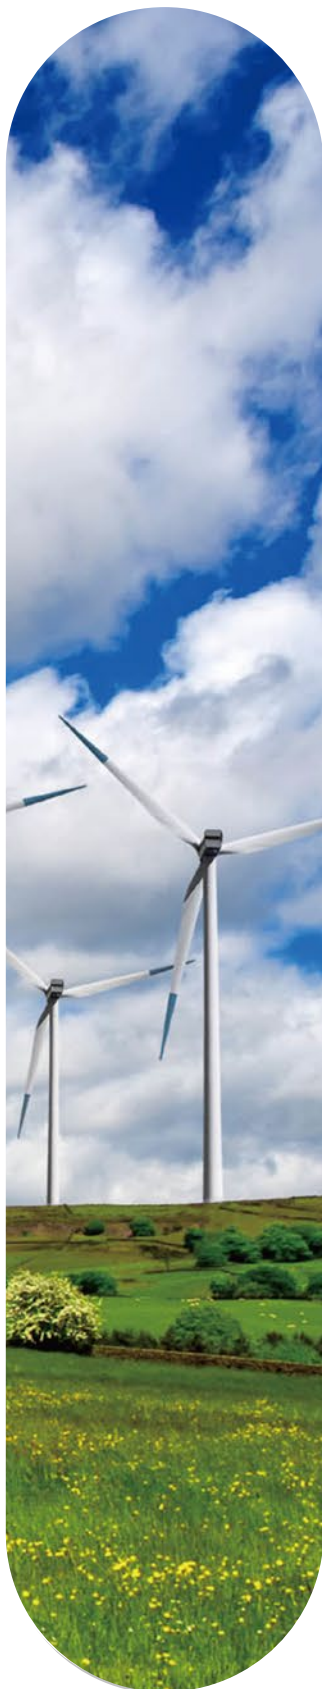

1

Avoid debris falling into live parts

2

Keep a good distance from the ground to allow ventilation

3

The transformer is equipped with devices for safe handling

4

Ensure that the power supply voltage is not higher than the rated voltage

5

The transformer should be cleaned regularly, especially if it is installed in the polluted environment

6

Secure high voltage and low voltage cables to prevent movement

7

Connect the protection circuit to the monitoring system. Check whether the grounding is effective

8

Check the tightening torque of the high pressure tap connection rod and the high pressure connection


9

Connect the protection circuit to the monitoring system. Check whether the grounding is effective

10

Ensure good ventilation

④ INSTALLATION AND AFTER-SALES SERVICE

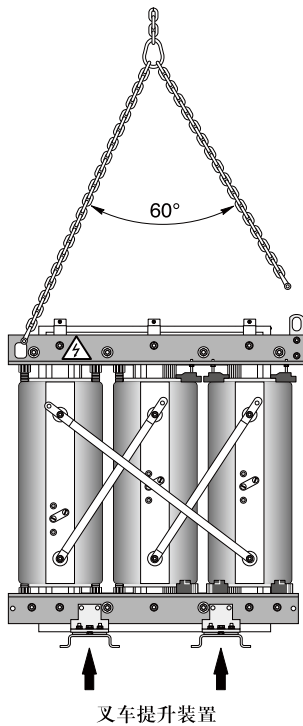

carry

Use the 4 lifting lugs of the transformer (it must be lifted vertically, not obliquely); For the transformer with 2 lifting lugs in the center of the top of the shell, use 2 lifting lugs. The included angle formed by the sling shall not be greater than 60° .


First, check the forklift's forking capacity. If appropriate, the fork arm shall be inserted into the base channel after removing the roller.

The transformer with or without enclosure shall be hauled from the base. For this purpose, holes with a diameter of 27mm are opened on each side of the base. It can be dragged from two directions: the axial direction of the base and the direction perpendicular to this axis.


storage

Hengfengyou transformer shall avoid being polluted by dripping water and sand dust (such as masonry and sand blasting) during storage. If hengfengyou transformer is supplied with a plastic cover, it shall be covered on the equipment during storage. Hengfengyou transformer can be stored in an environment with a minimum room temperature of -25°C and a maximum room temperature of 50°C .

No gas or conductive dust that seriously affects the insulation of the transformer; No explosion hazard, no corrosion of electrical components

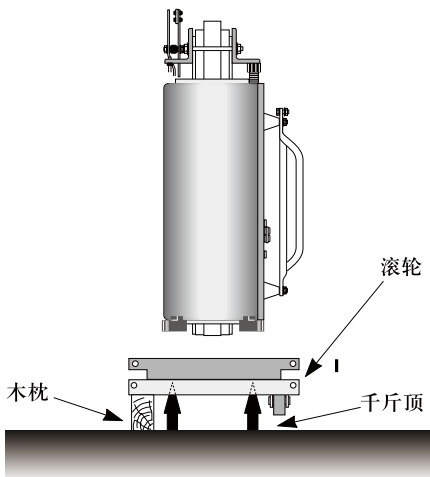


© INSTALLATION AND AFTER-SALES SERVICE

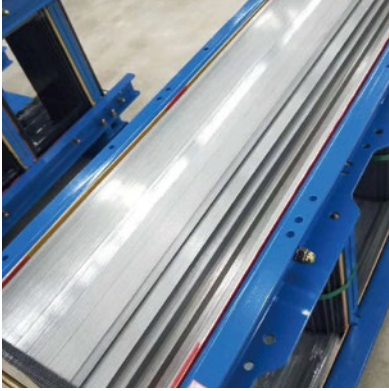


Installation site

· The transformer shall be installed in a dry, flat place where water is not easy to enter. The installation site shall have sufficient ventilation to ensure that all heat of the transformer can be dissipated

· No load shall be supported anywhere on the enclosure except the power supply cable of the transformer. In addition to correctly installing the connecting cable according to the relevant drawings, facilities or accessories not supplied by the manufacturer or without permission are not allowed to be installed in the shell, otherwise, the user shall bear the risk. For the transformation, connection and installation of any accessories, please consult our hengfengyou technicians.

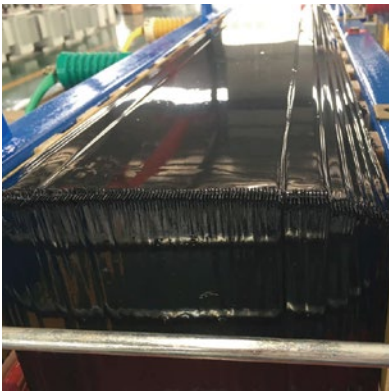

· Under no circumstances shall HV and LV connecting cables be fixed on the transformer core and winding. The distance between high-voltage cable, low-voltage cable, or low-voltage bus and the surface of high-voltage winding shall be at least 120mm; However, the minimum distance on the high pressure side refers to the distance to the outermost triangular connecting rod. Special attention shall be paid to the grounding of the shielding layer of high-voltage cable.

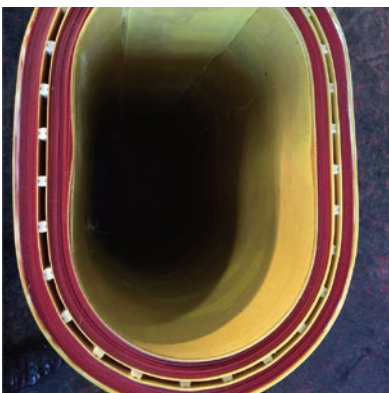

🔄 INSTALLATION AND AFTER-SALES SERVICE

INSPECTION BEFORE OPERATION

· Auxiliary wiring

The auxiliary wiring on the transformer (connected to plug-in connector) shall be fixed on a fixed support (without any binding) and have sufficient clearance from live parts. The minimum clearance to be considered depends on the voltage level shown on the nameplate.

· Parallel operation

Check whether the high voltage and low voltage of these transformers are the same, and check whether the performance parameters are the same, especially whether the connection group and impedance voltage are the same.

· Make sure the tapping positions are the same

Among the transformers in parallel operation, the capacity of the transformer with the largest capacity shall not exceed more than twice that of the transformer with the smallest capacity.

· Insulation test

Use a 2500V insulation resistance megger to check the insulation of high voltage and low voltage to ground. The insulation of high voltage to low voltage (the insulation resistance value is about: high voltage to ground $\geq 250\text{M}$, low voltage to ground $\geq 50\text{M}$, high voltage to low voltage $\geq 250\text{M}$). If the measured value is significantly lower than the above value, check whether the transformer is damp. In case of moisture, dry it and repeat the above inspection.

· Transformer cleaning

Check the general cleanliness of the transformer and all cable and bus interfaces to ensure that they meet the relevant protection grade

Inspection in operation

Under normal use and environmental conditions, check the transformer once a year, dust around the transformer and accessories, and fasten lead terminals, pins, grounding screws, connecting bus screws, etc.

🔄 INSTALLATION AND AFTER-SALES SERVICE

Quality Control:

We have established strict SQA working procedures and ISO standards in the development, production, sales and after-sales of electrical products, so as to provide customers with first-class products and the best service.

Our team:

1. Our electrical engineer has more than 10 years of working experience

Our workshop workers are all skilled industrial workers who have received three months 'pre-job training

3. Our sales team has been extensively trained by management consultants to provide professional solutions for customers

4. Our technical team can provide customers with 24-hour technical support world wide

5. Our customer service team ensures that orders are delivered on time.

6. professional after-sales service technicians can ensure the correct commissioning and operation of the transformer.



TRANSFORMER PACKAGING AND TRANSPORTATION

PRE-SALE SERVICE:

1. ISO certified excellent Manufacturer
2. Third-party authoritative certifications: CE, CB, UL, CSA etc
3. Flexible payment: T/T, LC,
4. Sufficient inventory, fast delivery time and long validity of the price
5. The whole process of picture tracking can be realized in production and transportation
6. Experienced professional sales team and a strong technical team
7. Sincerely invite customers to visit the company for guidance

AFTER-SALES SERVICE:

1. If there is any quality problem after receiving the goods, you can return the goods free of charge or ship new products
2. We provide our customers with a 1-year product warranty
3. Provide 24-hour, 365-day technical guidance worldwide
4. The VIP customers enjoy our promotional activity
trained by management consultants, is able to provide professional solutions for customers.
4. Our technical team is ready for 24-hour technical support worldwide.
5. Our customer service team ensures on time delivery.



Call Us For Details



HENG FENGYOU[®]

· Make Life Better ·

智能电气全球服务提供商, 让生活更美好

SMART ELECTRIC GLOBAL SERVICE PROVIDER, MAKE LIFE BETTER

QINGDAO HENGFENGYOU ELECTRICAL ENGINEERING CO., LTD

Tel: +86-532-8793 6206

WhatsApp: JACK +86 158 5325 2696 MARTIN +86 135 8926 2999

Website: <http://www.hengfengyou.com>

Email: hfy@hengfengyou.com

service@hengfengyou.com

Address: No.638 Zhongcheng Road, Chengyang District, Qingdao City, China

